

# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5500 Rosehill Rd bldg 11  
Sarasota FL 34233

[www.MISInspect.com](http://www.MISInspect.com)

7186 21st Street E.  
Sarasota, FL 34243  
(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|   |                 |                 |
|---|-----------------|-----------------|
| Inspection Date: November 27, 2018        |                 |                 |
| <b>Owner Information</b>                  |                 |                 |
| Owner Name: Admiral's Walk, A Condominium |                 | Contact Person: |
| Address: 5500 Rosehill Rd bldg 11         |                 | Home Phone:     |
| City: Sarasota                            | Zip: 34233      | Work Phone:     |
| County: Sarasota                          |                 | Cell Phone:     |
| Insurance Company:                        |                 | Policy #:       |
| Year of Home: 2002                        | # of Stories: 2 | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

- Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_ / \_\_\_ / \_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
- Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | 02 / 27 / 2017          | _____                         | 2017   | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | _ / _ / _               | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | _ / _ / _               | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | _ / _ / _               | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | _ / _ / _               | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | _ / _ / _               | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
  - B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
  - C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
  - D. No roof coverings meet the requirements of Answer "A" or "B".
- Roof Deck Attachment:** What is the weakest form of roof deck attachment?
    - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
    - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field.-OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
    - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials ZM Property Address 5500 Rosehill Rd bldg 11 Sarasota FL 34233

or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a ½" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.

- B. Clips
  - Metal connectors that do not wrap over the top of the truss/rafter, **or**
  - Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.
- C. Single Wraps
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.
- D. Double Wraps
  - Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.
- E. Structural      Anchor bolts structurally connected or reinforced concrete roof.
- F. Other: \_\_\_\_\_
- G. Unknown or unidentified
- H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof      Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof      Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof      Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials ZM Property Address \_\_\_\_\_ 5500 Rosehill Rd bldg 11 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

7. **Opening Protection:** What is the weakest form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist.
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials ZM Property Address 5500 Rosehill Rd bldg 11 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.

|   |  |   |
|---|--|---|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |  |   |
| Qualified Inspector Name:<br><b>Zachary Marquette</b>   | License Type:<br><b>Home Inspector</b> | License or Certificate #:<br><b>HI 5086, 18020398</b> |
| Inspection Company:<br><b>Marquette Inspection, Inc.</b>  | Phone:<br><b>(941)358-1901</b>         |   |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Zachary Marquette am a qualified inspector and I personally performed the inspection or (*licensed*  
(print name)  
*contractors and professional engineers only*) I had my employee ( \_\_\_\_\_ ) perform the inspection  
(print name of inspector)  
and I agree to be responsible for his/her work.

Qualified Inspector Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**

**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: \_\_\_\_\_ Date: November 27, 2018



**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials ZM Property Address \_\_\_\_\_ 5500 Rosehill Rd bldg 11 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.



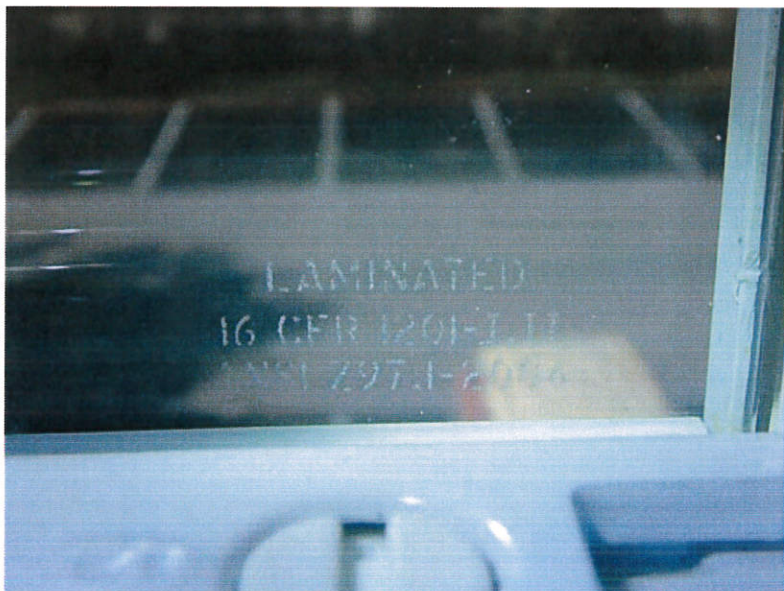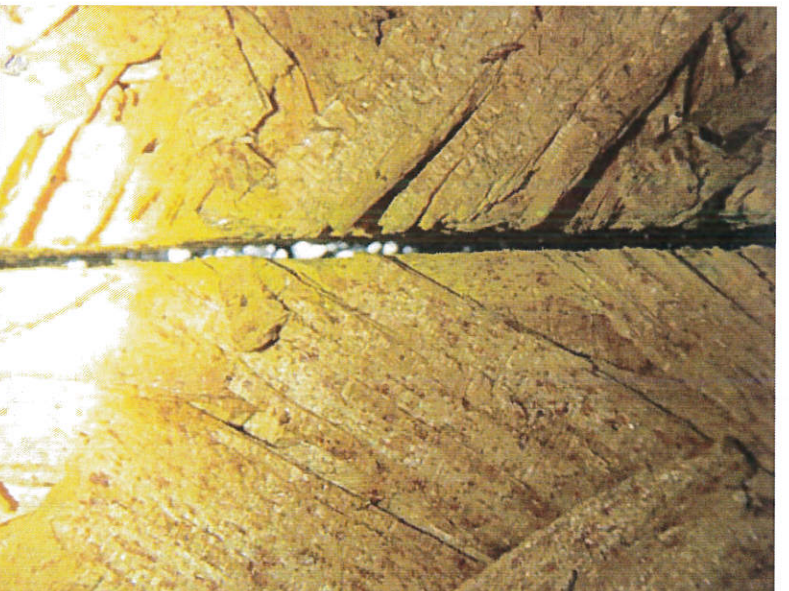



# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**“7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for “Cyclic Pressure and Large Missile Impact” (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, **and** 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
- \_ American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 **and** ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115”

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*



**THERMATRU**  
DOORS

Maumee, Ohio  
www.thermatru.com  
800-843-7628

IT LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Thermo-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAMI certification, Florida and TDI approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Thermo-Tru Classic-Craft, Fiber-Glass, Smooth-Star, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshal requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-01889-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|  |                            |   |
|--|----------------------------|---|
| U-Factor   |                            | Solar Heat Gain Coefficient   |
| <b>0.42</b><br>(U.S./I-P)  | <b>2.38</b><br>(Metric/SI) | <b>0.27</b>   |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>  |                            |   |
| Visible Transmittance  |                            |   |
| <b>0.50</b>  |                            |   |
| <small>Manufacturer stipulated that the ratings provided are based on applicable NFRC procedures for determining product performance. NFRC ratings are determined for a fixed set of environmental conditions and are not warranted for any specific product size. NFRC does not recommend the use of any product for any specific use. Consult manufacturer's literature for complete product details. Visit <a href="http://www.nfrc.org">www.nfrc.org</a></small> |                            |   |
|  |                            | <small>License # 4144-02<br/>Silver Line Windows<br/>2127 Single Hung - IMPACT<br/>Manufacturer Stipulates Certification to the following standards</small> |
| <b>STANDARD</b>  |                            | <b>RATING</b>   |
| APPA/WDMA/CSA 101/I.S. 2/A440-08   |                            | CLASS R-PG55 Size Tested 52 x 73 in<br>DP +55/-55 psf   |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - 4VHZ   |                            | Wind Zone 4 - Missile Level D<br>Cyclic Pressure +55/-50  |
| FL 14911   |                            |   |
| <small>Glazing 3 0 mm Double Str AN Outer/<br/>6 7 mm 090 55 Lami Inner<br/>Laminator: NE LC Interlayer: HVB 030</small>   |                            |   |
| <b>ATL N-7</b>   |                            | <small>Complies with HUD UM Bulletin 111<br/>IGCC/IGMA 03-17<br/><b>23707987.14.2</b></small>   |

Meets or exceeds NEC, CBC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program

# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5501 Rosehill Rd., Bldg 12  
Sarasota 34233

[www.MISInspect.com](http://www.MISInspect.com)

7186 21st Street E.  
Sarasota, FL 34243  
(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|  |                        |                 |
|--|------------------------|-----------------|
| Inspection Date: <b>November 27, 2018</b>        |                        |                 |
| <b>Owner Information</b>                         |                        |                 |
| Owner Name: <b>Admirals Walk , A Condominium</b> |                        | Contact Person: |
| Address: <b>5501 Rosehill Rd., Bldg 12</b>       |                        | Home Phone:     |
| City: <b>Sarasota</b>                            | Zip: <b>34233</b>      | Work Phone:     |
| County: <b>Sarasota</b>                          |                        | Cell Phone:     |
| Insurance Company:                               |                        | Policy #:       |
| Year of Home: <b>2002</b>                        | # of Stories: <b>2</b> | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

- Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2018
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_\_/\_\_\_\_/\_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
- Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | <u>01 / 19 / 2017</u>   | _____                         | <u>2017</u>                                  | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
  - B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
  - C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
  - D. No roof coverings meet the requirements of Answer "A" or "B".
- Roof Deck Attachment:** What is the **weakest** form of roof deck attachment?
    - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
    - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
    - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials WM Property Address 5501 Rosehill Rd., Bldg 12 Sarasota 34233

or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a 1/2" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.

- B. Clips
  - Metal connectors that do not wrap over the top of the truss/rafter, **or**
  - Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.
- C. Single Wraps
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.
- D. Double Wraps
  - Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.
- E. Structural      Anchor bolts structurally connected or reinforced concrete roof.
- F. Other: \_\_\_\_\_
- G. Unknown or unidentified
- H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof      Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof      Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof      Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials WM Property Address \_\_\_\_\_ 5501 Rosehill Rd., Bldg 12 Sarasota \_\_\_\_\_ 34233

**\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.**

7. **Opening Protection:** What is the weakest form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials WM Property Address 5501 Rosehill Rd., Bldg 12 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.


|   |                                 |                                     |
|---|---------------------------------|-------------------------------------|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |                                 |                                     |
| Qualified Inspector Name:<br>Wade Marquette   | License Type:<br>Home Inspector | License or Certificate #:<br>HI2853 |
| Inspection Company:<br>Marquette Inspection, Inc  | Phone:<br>(941)358-1901         |                                     |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Wade Marquette am a qualified inspector and I personally performed the inspection or (*licensed (print name)*  
*contractors and professional engineers only*) I had my employee ( Wade Marquette ) perform the inspection  
*(print name of inspector)*  
and I agree to be responsible for his/her work.

Qualified Inspector Signature:  Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**


**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: \_\_\_\_\_ Date: November 27, 2018


**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials WM Property Address 5501 Rosehill Rd., Bldg 12 Sarasota 34233

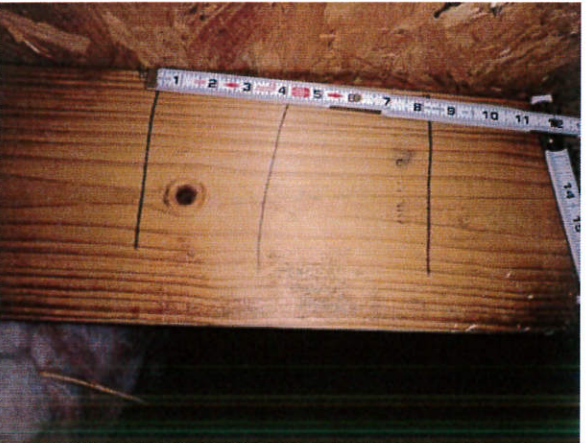



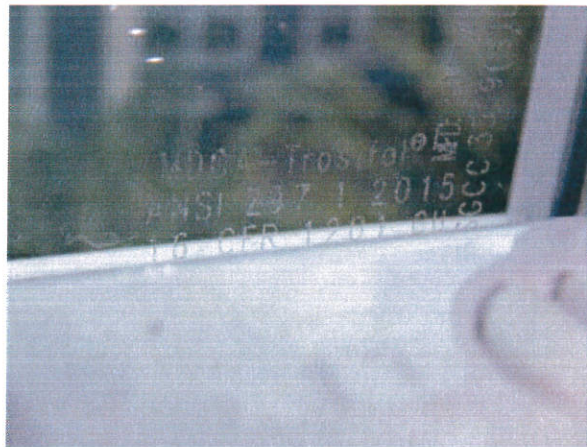



# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**“7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for “Cyclic Pressure and Large Missile Impact” (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, and 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, and 203
- \_ American Society for Testing and Materials (ASTM) E 1886 and ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 and ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115”

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*

**THERMA-TRU®**  
**DOORS**

Maumee, Ohio  
www.thermatru.com  
800-843-7628

IT LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Thermo-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAMI certification, Florida and TDI approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Thermo-Tru Classic-Craft, Fiber-Glassico, Smooth-Star, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshall requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official.

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-0109-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|  |   |  |
|--|---|--|
| U-Factor   |   | Solar Heat Gain Coefficient  |
| <b>0.42</b><br>(U.S./I-P)  | <b>2.38</b><br>(Metric/SI)  | <b>0.27</b>  |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>  |   |  |
| Visible Transmittance  |   |  |
| <b>0.50</b>  |   |  |
| <small>Manufacturer stipulated that the ratings on this product are based on applicable NFRC procedures for determining product performance. NFRC ratings are determined for a fixed set of environmental conditions and specific product size. NFRC does not recommend any product and does not warrant the suitability of any product for any specific use. Consult manufacturer's literature for other product performance information. nrc.org</small> |   |  |
|  |   | <small>License # 4141H-07</small><br>Silver Line Windows<br>2127 Single Hung - IMPACT<br>Manufacturer Stipulates Certification to the following standards: |
| <b>STANDARD</b>  | <b>RATING</b>   |  |
| APHA/WDMA/CSA 101/I.S. 2/A440-08   | CLASS R-PG55 Size Tested 52 x 73 In<br>DP +55/-55 psf   |  |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - 4VH2   | Wind Zone 4 - Mississ Level D<br>Cycln Pressure +55/-50   |  |
| FL 14911   |   |  |
| Glazing 3.0 mm Double Str AN Outer /<br>6.7 mm 090 SS Lami Inner<br>Laminator: NE LC Interlayer: HVB 090   |   |  |
| <b>ATL N-7</b>   | Complies with HUD UM Bulletin 111<br>IGCC <sub>a</sub> /IGMA <sub>a</sub> 03-17<br><b>23707987.14.2</b> |  |

Meets or exceeds MEC, CEC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program

# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5511 Rosehill Rd bldg 13  
Sarasota FL 34233

[www.MISInspect.com](http://www.MISInspect.com)

7186 21st Street E.  
Sarasota, FL 34243  
(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|   |                 |                 |
|---|-----------------|-----------------|
| Inspection Date: November 27, 2018        |                 |                 |
| <b>Owner Information</b>                  |                 |                 |
| Owner Name: Admiral's Walk, A Condominium |                 | Contact Person: |
| Address: 5511 Rosehill Rd bldg 13         |                 | Home Phone:     |
| City: Sarasota                            | Zip: 34233      | Work Phone:     |
| County: Sarasota                          |                 | Cell Phone:     |
| Insurance Company:                        |                 | Policy #:       |
| Year of Home: 2002                        | # of Stories: 2 | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

- Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_\_/\_\_\_\_/\_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
- Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | 03 / 02 / 2017          | _____                         | 2017   | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ____/____/____          | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
- B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
- C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
- D. No roof coverings meet the requirements of Answer "A" or "B".

- Roof Deck Attachment:** What is the weakest form of roof deck attachment?
  - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
  - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
  - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials ZM Property Address 5511 Rosehill Rd bldg 13 Sarasota FL 34233

or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a 1/2" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.

B. Clips

- Metal connectors that do not wrap over the top of the truss/rafter, **or**
- Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.

C. Single Wraps

Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.

D. Double Wraps

- Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
- Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.

E. Structural      Anchor bolts structurally connected or reinforced concrete roof.

F. Other: \_\_\_\_\_

G. Unknown or unidentified

H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof      Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof      Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof      Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials ZM Property Address \_\_\_\_\_ 5511 Rosehill Rd bldg 13 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

7. **Opening Protection:** What is the **weakest** form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials ZM Property Address 5511 Rosehill Rd bldg 13 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.



- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.

|   |  |   |
|---|--|---|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |  |   |
| Qualified Inspector Name:<br><b>Zachary Marquette</b>   | License Type:<br><b>Home Inspector</b> | License or Certificate #:<br><b>HI 5086, 18020398</b> |
| Inspection Company:<br><b>Marquette Inspection, Inc.</b>  | Phone:<br><b>(941)358-1901</b>         |   |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Zachary Marquette am a qualified inspector and I personally performed the inspection or (*licensed*  
(print name)  
*contractors and professional engineers only*) I had my employee ( \_\_\_\_\_ ) perform the inspection  
(print name of inspector)  
and I agree to be responsible for his/her work.

Qualified Inspector Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**

**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: \_\_\_\_\_ Date: November 27, 2018




**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials ZM Property Address 5511 Rosehill Rd bldg 13 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.



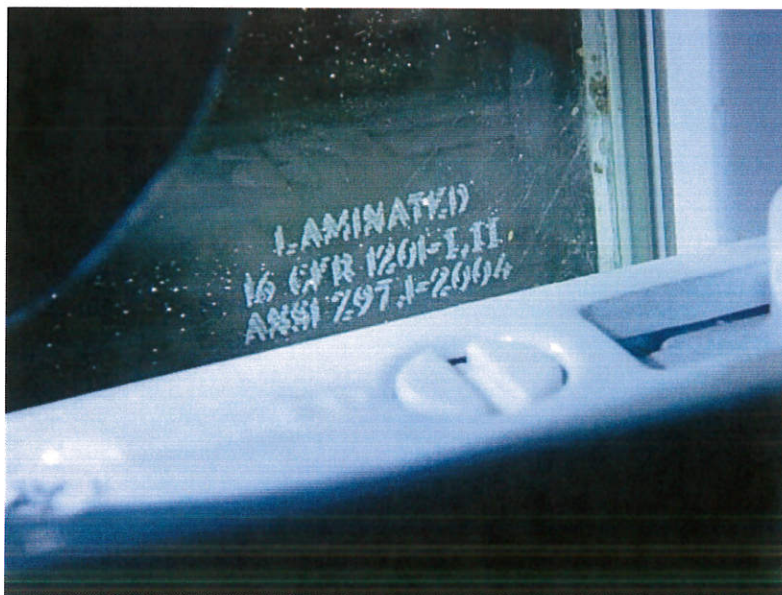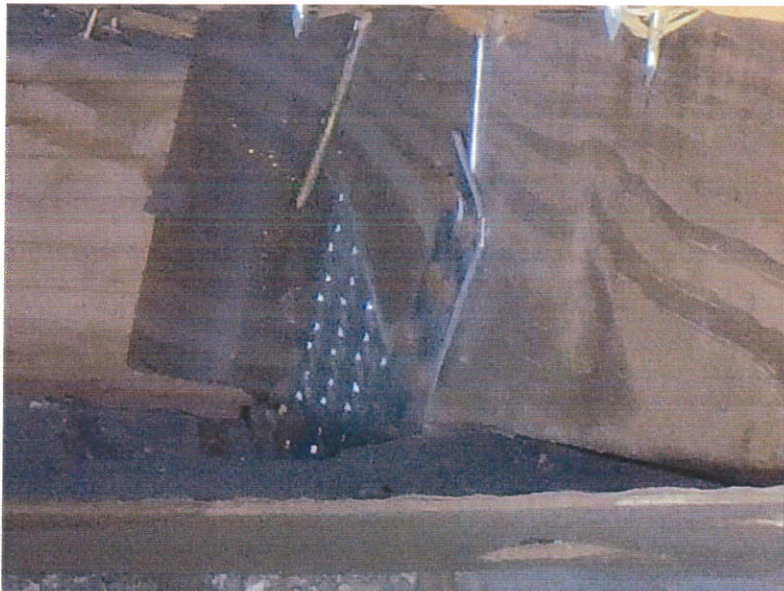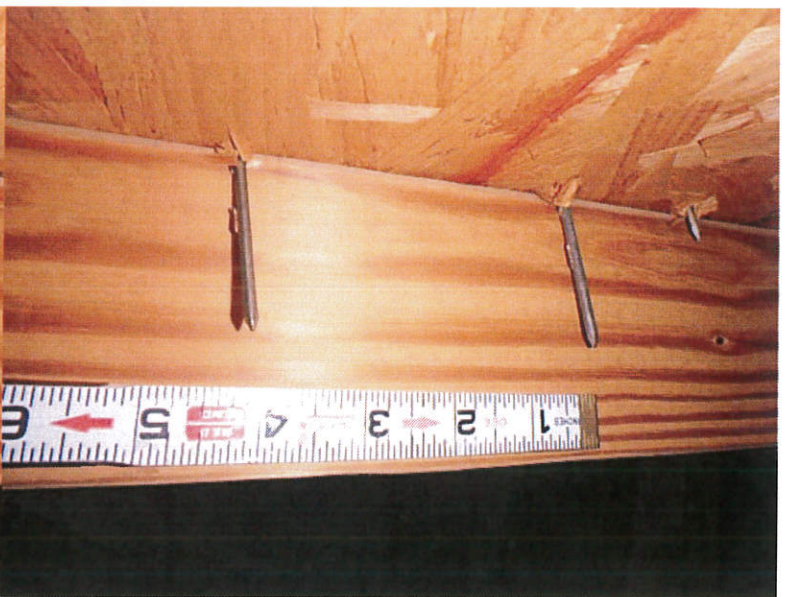



# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**“7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for “Cyclic Pressure and Large Missile Impact” (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, and 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, and 203
- \_ American Society for Testing and Materials (ASTM) E 1886 and ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 and ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115”

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*

**THERMATRU**  
DOORS

Maumee, Ohio  
www.thermatru.com  
800-843-7628

IT LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Therma-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFPA certification, ENERGY STAR® qualification, HUD certification, NAHB certification, Florida and TDJ approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Therma-Tru Classic-Craft, Fiber-Glassco, Smooth-Star, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshall requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official.

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-0159-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|   |                            |  |
|---|----------------------------|--|
| U-Factor  |                            | Solar Heat Gain Coefficient  |
| <b>0.42</b><br>(U.S./I-P)   | <b>2.38</b><br>(Metric/SI) | <b>0.27</b>  |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>   |                            |  |
| Visible Transmittance   |                            |  |
| <b>0.50</b>   |                            |  |
| <small>Manufacturer states that these ratings conform to applicable NFRC procedures for determining product performance. NFRC ratings are determined for a fixed set of environmental conditions and a specific product size. NFRC does not recommend any consultant and does not warrant the suitability of any product for any specific use. Consult manufacturer's literature for complete product performance information. <a href="http://www.nfrc.org">www.nfrc.org</a></small> |                            |  |
|   |                            | <small>License # 41414-H-02</small><br>Silver Line Window<br>2127 Single Hung - IMPACT<br>Manufacturer States Certification to the following standards |
| <b>STANDARD</b>   |                            | <b>RATING</b>  |
| APHA/WDMA/CSA 101/1.5 2/A440-08   |                            | CLASS R-P655 Size Tested 52 x 73 In<br>DP +55/-55 pcf  |
| ASTM E1996-12/ASTM E1086-05<br>TAS-201 thru 203 - 4VHZ  |                            | Wind Zone 4 - Missile Level D<br>Cyclic Pressure +55/-50   |
| FL 14911  |                            |  |
| Glazing 3.0 mm Double Str AN Outer<br>6.7 mm 090 SS Lami Inner<br>Laminator: NE LC Interlayer: PVB 090  |                            |  |
| <b>ATL N-7</b>  |                            | Complies with HUD UM Bulletin 111<br>IGCC, IGMA 03-17<br><b>23707987.14.2</b>  |

Meets or exceeds MEC, CEC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program

# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5510 Rosehill Rd., Bldg 14  
Sarasota 34233

[www.MISInspect.com](http://www.MISInspect.com)

7186 21st Street E.  
Sarasota, FL 34243  
(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|   |                        |                 |
|---|------------------------|-----------------|
| Inspection Date: <b>November 27, 2018</b>       |                        |                 |
| <b>Owner Information</b>                        |                        |                 |
| Owner Name: <b>Admirals Walk, A Condominium</b> |                        | Contact Person: |
| Address: <b>5510 Rosehill Rd., Bldg 14</b>      |                        | Home Phone:     |
| City: <b>Sarasota</b>                           | Zip: <b>34233</b>      | Work Phone:     |
| County: <b>Sarasota</b>                         |                        | Cell Phone:     |
| Insurance Company:                              |                        | Policy #:       |
| Year of Home: <b>2002</b>                       | # of Stories: <b>2</b> | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

- Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_/\_\_\_/\_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
- Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date             | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | <u>01</u> / <u>20</u> / <u>2017</u> | _____                         | <u>2017</u>                                  | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
  - B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
  - C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
  - D. No roof coverings meet the requirements of Answer "A" or "B".
- Roof Deck Attachment:** What is the weakest form of roof deck attachment?
    - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
    - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
    - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials WM Property Address 5510 Rosehill Rd., Bldg 14 Sarasota 34233



or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
  - E. Other: \_\_\_\_\_
  - F. Unknown or unidentified.
  - G. No attic access.
4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)
- A. Toe Nails
    - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
    - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
  - Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a ½" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.
- B. Clips
    - Metal connectors that do not wrap over the top of the truss/rafter, **or**
    - Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.
  - C. Single Wraps
    - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.
  - D. Double Wraps
    - Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
    - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.
  - E. Structural      Anchor bolts structurally connected or reinforced concrete roof.
  - F. Other: \_\_\_\_\_
  - G. Unknown or unidentified
  - H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof      Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof      Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof      Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials WM Property Address 5510 Rosehill Rd., Bldg 14 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

7. **Opening Protection:** What is the **weakest** form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials WM Property Address 5510 Rosehill Rd., Bldg 14 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.

|   |                                 |                                     |
|---|---------------------------------|-------------------------------------|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |                                 |                                     |
| Qualified Inspector Name:<br>Wade Marquette   | License Type:<br>Home Inspector | License or Certificate #:<br>HI2853 |
| Inspection Company:<br>Marquette Inspection, Inc  | Phone:<br>(941)358-1901         |                                     |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Wade Marquette am a qualified inspector and I personally performed the inspection or (*licensed (print name)*  
*contractors and professional engineers only*) I had my employee ( Wade Marquette ) perform the inspection  
(print name of inspector)  
and I agree to be responsible for his/her work.

Qualified Inspector Signature:  Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**

**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials WM Property Address 5510 Rosehill Rd., Bldg 14 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.







# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**“7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for “Cyclic Pressure and Large Missile Impact” (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, **and** 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
- \_ American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 **and** ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115”

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*

**THERMA TRU**  
DOORS

Maumee, Ohio  
www.thermatru.com  
800-843-7628

ITLABEL MAY 13

\* Performance data, product approvals and product certifications are available for certain Therma-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAIMI certification, Florida and TDJ approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Therma-Tru Classic-Craft, Fiber-Glass, Smooth-Star, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-A-1 and meet the California State Fire Marshall requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-01369-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|  |                     |  |
|--|---------------------|--|
| U-Factor   |                     | Solar Heat Gain Coefficient  |
| 0.42<br>(U.S./I-P)   | 2.38<br>(Metric/SI) | 0.27   |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>  |                     |  |
| Visible Transmittance  |                     |  |
| 0.50   |                     |  |
| <small>Manufacturer stipulates that the ratings on this product are determined for a limited set of environmental conditions and do not warrant the suitability of any product for any specific use. Consult manufacturer's literature for complete product information. nfrcc.org</small> |                     |  |
|  |                     | <small>License # 4114H-02<br/>Line Window<br/>2127 Single Hung - IMPACT<br/>Manufacturer Stipulates Certification to the following standards</small> |
| <b>STANDARD</b>  |                     | <b>RATING</b>  |
| AAMA/WDMA/CSA 101/I.5.2/A440-08  |                     | CLASS R-P655 Size Tested 52 x 73 In<br>DP +55/-55 psf  |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - 4VHZ   |                     | Wind Zone 4 - Missile Level D<br>Cyclic Pressure +55/-50   |
| FL 14911   |                     |  |
| <small>Glazing 3.0 mm Double Str AN Outer/<br/>6.7 mm 690 SS Lami Inner<br/>Laminator: NE CC Interlayer: JVB 090</small>   |                     |  |
| ATL N-7  |                     | <small>Complies with HUD UM Bulletin 111<br/>16CC/IGMA 03-17<br/>23707987.14.2</small>   |

Meets or exceeds NEC, CEC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program



# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5521 Rosehill Rd bldg 15  
Sarasota FL 34233

[www.MISInspect.com](http://www.MISInspect.com)

7186 21st Street E.  
Sarasota, FL 34243  
(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|   |                 |                 |
|---|-----------------|-----------------|
| Inspection Date: November 27, 2018        |                 |                 |
| <b>Owner Information</b>                  |                 |                 |
| Owner Name: Admiral's Walk, A Condominium |                 | Contact Person: |
| Address: 5521 Rosehill Rd bldg 15         |                 | Home Phone:     |
| City: Sarasota                            | Zip: 34233      | Work Phone:     |
| County: Sarasota                          |                 | Cell Phone:     |
| Insurance Company:                        |                 | Policy #:       |
| Year of Home: 2002                        | # of Stories: 2 | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

1. **Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_/\_\_\_/\_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
2. **Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date             | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | <u>07</u> / <u>10</u> / <u>2017</u> | _____                         | <u>2017</u>                                  | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
  - B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
  - C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
  - D. No roof coverings meet the requirements of Answer "A" or "B".
3. **Roof Deck Attachment:** What is the **weakest** form of roof deck attachment?
    - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
    - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
    - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials ZM Property Address 5521 Rosehill Rd bldg 15 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure.

or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a 1/2" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.

- B. Clips
  - Metal connectors that do not wrap over the top of the truss/rafter, **or**
  - Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.
- C. Single Wraps
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.
- D. Double Wraps
  - Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.
- E. Structural      Anchor bolts structurally connected or reinforced concrete roof.
- F. Other: \_\_\_\_\_
- G. Unknown or unidentified
- H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof      Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof      Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof      Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials ZM Property Address \_\_\_\_\_ 5521 Rosehill Rd bldg 15 Sarasota FL 34233

**\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.**

7. **Opening Protection:** What is the **weakest** form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials ZM Property Address 5521 Rosehill Rd bldg 15 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.

|   |  |   |
|---|--|---|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |  |   |
| Qualified Inspector Name:<br><b>Zachary Marquette</b>   | License Type:<br><b>Home Inspector</b> | License or Certificate #:<br><b>HI 5086, 18020398</b> |
| Inspection Company:<br><b>Marquette Inspection, Inc.</b>  | Phone:<br><b>(941)358-1901</b>         |   |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Zachary Marquette am a qualified inspector and I personally performed the inspection or (*licensed (print name)*  
*contractors and professional engineers only*) I had my employee ( \_\_\_\_\_ ) perform the inspection  
(print name of inspector)  
and I agree to be responsible for his/her work.

Qualified Inspector Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**

**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials ZM Property Address \_\_\_\_\_ 5521 Rosehill Rd bldg 15 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.







# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**"7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, and 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, and 203
- \_ American Society for Testing and Materials (ASTM) E 1886 and ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 and ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115"

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*



**THERMATRU®**  
**DOORS**

Maumee, Ohio  
www.thermatru.com  
800-843-7628

ETL LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Thermo-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAIMI certification, Florida and TDI approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Thermo-Tru Classic-Craft, Fiber-Glassico, Smooth-Star, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshal requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-01889-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|   |                     |   |
|---|---------------------|---|
| U-Factor  |                     | Solar Heat Gain Coefficient   |
| 0.42<br>(U.S./I-P)  | 2.38<br>(Metric/SI) | 0.27  |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>   |                     |   |
| Visible Transmittance   |                     |   |
| 0.50  |                     |   |
| <small>Manufacturer stipulates that the ratings conform to applicable NFRC procedures for determining product performance. NFRC ratings are determined for a fixed set of environmental conditions at a specific product size. NFRC does not recommend any product and does not warrant the suitability of any product for any specific use. Consult manufacturer's literature for complete product details. Visit <a href="http://www.nfrc.org">www.nfrc.org</a></small> |                     |   |
|   |                     | <small>Manufacturer Stipulates Certification to the following standards</small>       |
| <b>STANDARD</b>   |                     | <b>RATING</b>   |
| AAMA/WDMA/CSA 101/I.5.2/A440-08   |                     | CLASS R-P655 Size Tested 52 x 73 in.<br>DP +55/-55 psf                                |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - HVHZ  |                     | Wind Zone 4 / Missile Level D<br>Cyclic Pressure +55/-50                              |
| FL 14911  |                     |   |
| <small>Glazing 3/8 in Double Str AN Outer /<br/>5/8 in 690 SS Lami Inner<br/>Laminator: NE CC Interlayer: HVB 09C</small>   |                     |   |
| ATL N-7   |                     | <small>Complies with HUD UM Bulletin 111<br/>16CC/IGMA 03-17</small><br>23707987.14.2 |

Meets or exceeds NEC, CBC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program

# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5520 Rosehill Rd., Bldg 16  
Sarasota 34233

[www.MISinspect.com](http://www.MISinspect.com)

7186 21st Street E.  
Sarasota, FL 34243  
(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|   |                        |                 |
|---|------------------------|-----------------|
| Inspection Date: <b>November 27, 2018</b>       |                        |                 |
| <b>Owner Information</b>                        |                        |                 |
| Owner Name: <b>Admirals Walk, A Condominium</b> |                        | Contact Person: |
| Address: <b>5520 Rosehill Rd., Bldg 16</b>      |                        | Home Phone:     |
| City: <b>Sarasota</b>                           | Zip: <b>34233</b>      | Work Phone:     |
| County: <b>Sarasota</b>                         |                        | Cell Phone:     |
| Insurance Company:                              |                        | Policy #:       |
| Year of Home: <b>2002</b>                       | # of Stories: <b>2</b> | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

1. **Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_/\_\_\_/\_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
2. **Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date             | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | <u>07</u> / <u>10</u> / <u>2017</u> | _____                         | <u>2017</u>                                  | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
  - B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
  - C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
  - D. No roof coverings meet the requirements of Answer "A" or "B".
3. **Roof Deck Attachment:** What is the **weakest** form of roof deck attachment?
    - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
    - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
    - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials WM Property Address 5520 Rosehill Rd., Bldg 16 Sarasota 34233

or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a 1/2" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.
- B. Clips
  - Metal connectors that do not wrap over the top of the truss/rafter, **or**
  - Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.
- C. Single Wraps
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.
- D. Double Wraps
  - Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.
- E. Structural Anchor bolts structurally connected or reinforced concrete roof.
- F. Other: \_\_\_\_\_
- G. Unknown or unidentified
- H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials WM Property Address \_\_\_\_\_ 5520 Rosehill Rd., Bldg 16 Sarasota 34233

**\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.**

7. **Opening Protection:** What is the **weakest** form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials WM Property Address 5520 Rosehill Rd., Bldg 16 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.

|   |                                 |                                     |
|---|---------------------------------|-------------------------------------|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |                                 |                                     |
| Qualified Inspector Name:<br>Wade Marquette   | License Type:<br>Home Inspector | License or Certificate #:<br>HI2853 |
| Inspection Company:<br>Marquette Inspection, Inc  | Phone:<br>(941)358-1901         |                                     |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Wade Marquette am a qualified inspector and I personally performed the inspection or (*licensed contractors and professional engineers only*) I had my employee ( Wade Marquette ) perform the inspection  
(print name) (print name of inspector)  
and I agree to be responsible for his/her work.

Qualified Inspector Signature:  Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**


**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials WM Property Address 5520 Rosehill Rd., Bldg 16 Sarasota 34233

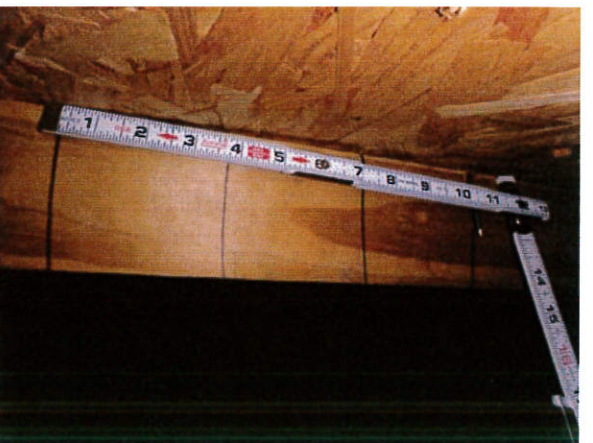







# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**“7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for “Cyclic Pressure and Large Missile Impact” (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, **and** 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
- \_ American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 **and** ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115”

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*

**THERMA-TRU**  
DOORS

Maumee, Ohio  
www.thermatru.com  
800-843-7628

ETL LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Thermo-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAIMI certification, Florida and TDI approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Thermo-Tru Classic-Craft, Fiber-Glass, Smooth-Star, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshall requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-01169-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|  |                     |   |
|--|---------------------|---|
| U-Factor   |                     | Solar Heat Gain Coefficient   |
| 0.42<br>(U.S./I-P)   | 2.38<br>(Metric/SI) | 0.27  |
| ADDITIONAL PERFORMANCE RATINGS   |                     |   |
| Visible Transmittance  |                     |   |
| 0.50   |                     |   |
| <small>Manufacturer stipulates that the ratings on this product are based on applicable NFRC procedures for determining product performance. NFRC ratings are determined for a fixed set of environmental conditions and a specific product size. NFRC does not recommend any product and does not warrant the suitability of any product for any specific use. Consult manufacturer's literature for complete product details. Visit <a href="http://www.nfrc.org">www.nfrc.org</a></small> |                     |   |
|  |                     | <small>License # 4114-H-02<br/>Silver Line Windows<br/>2127 Single Hung - IMPACT<br/>Manufacturer Stipulates Certification to the following standards</small> |
| STANDARD   |                     | RATING  |
| AAMA/WDMA/CSA 101/I.5.2/A440-08  |                     | CLASS R-P655 Size Tested 52 x 73 in<br>DP +55/-55 psf   |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - 4VHZ   |                     | Wind Zone 4 - Missile Level D<br>Cycle Pressure +55/-50   |
| FL 14911   |                     |   |
| Glazing 3.0 mm Double Str AN Outer/<br>6.7 mm 090 SS Lami Inner  |                     |   |
| Laminator: NE LC Interlayer: INB 090   |                     | Complies with HUD UM Bulletin 111<br>IGCC/IGMA 03-17  |
| ATL N-7  |                     | 23707987.14.2   |

Meets or exceeds NEC, CEC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program

# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5531 Rosehill Rd, Bldg 17  
Sarasota 34233

[www.MISinspect.com](http://www.MISinspect.com)

7186 21st Street E.  
Sarasota, FL 34243  
(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|  |                 |                 |
|--|-----------------|-----------------|
| Inspection Date: November 27, 2018       |                 |                 |
| <b>Owner Information</b>                 |                 |                 |
| Owner Name: Admirals Walk, A Condominium |                 | Contact Person: |
| Address: 5531 Rosehill Rd, Bldg 17       |                 | Home Phone:     |
| City: Sarasota                           | Zip: 34233      | Work Phone:     |
| County: Sarasota                         |                 | Cell Phone:     |
| Insurance Company:                       |                 | Policy #:       |
| Year of Home: 2002                       | # of Stories: 2 | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

- Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_\_/\_\_\_\_/\_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
- Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date             | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | <u>07</u> / <u>10</u> / <u>2017</u> | _____                         | <u>2017</u>                                  | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
  - B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
  - C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
  - D. No roof coverings meet the requirements of Answer "A" or "B".
- Roof Deck Attachment:** What is the **weakest** form of roof deck attachment?
    - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
    - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
    - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials WM Property Address 5531 Rosehill Rd, Bldg 17 Sarasota 34233

or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a 1/2" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.
- B. Clips
  - Metal connectors that do not wrap over the top of the truss/rafter, **or**
  - Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.
- C. Single Wraps
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.
- D. Double Wraps
  - Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.
- E. Structural Anchor bolts structurally connected or reinforced concrete roof.
- F. Other: \_\_\_\_\_
- G. Unknown or unidentified
- H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials WM Property Address 5531 Rosehill Rd, Bldg 17 Sarasota 34233

**\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.**

7. **Opening Protection:** What is the **weakest** form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials WM Property Address 5531 Rosehill Rd, Bldg 17 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.



- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.


|   |  |  |
|---|--|--|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |  |  |
| Qualified Inspector Name:<br><b>Wade Marquette</b>  | License Type:<br><b>Home Inspector</b> | License or Certificate #:<br><b>HI2853</b> |
| Inspection Company:<br><b>Marquette Inspection, Inc</b>   | Phone:<br><b>(941)358-1901</b>         |  |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Wade Marquette am a qualified inspector and I personally performed the inspection or (*licensed*  
(print name)  
*contractors and professional engineers only*) I had my employee ( Wade Marquette ) perform the inspection  
(print name of inspector)  
and I agree to be responsible for his/her work.

Qualified Inspector Signature:  Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**

**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: \_\_\_\_\_ Date: November 27, 2018



**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials WM Property Address 5531 Rosehill Rd, Bldg 17 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.



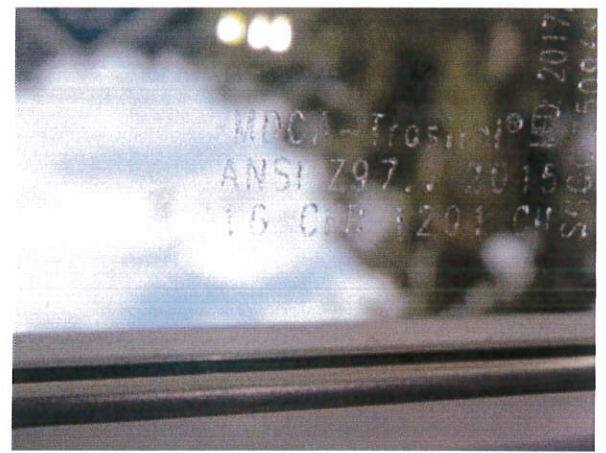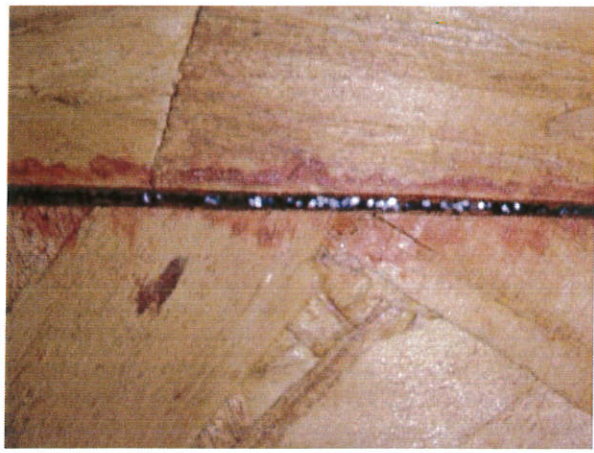



# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**“7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for “Cyclic Pressure and Large Missile Impact” (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, **and** 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
- \_ American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 **and** ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115”

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*

**THERMA TRU**  
DOORS

Maumee, Ohio  
www.thermatru.com  
800-843-7628

IT LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Therma-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAMI certification, Florida and TDJ approval and fire door certifications. **Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required.** All Therma-Tru Classic-Craft®, Fiber-Classic®, Smooth-Star®, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshal requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-01169-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|  |                            |   |
|--|----------------------------|---|
| U-Factor   |                            | Solar Heat Gain Coefficient   |
| <b>0.42</b><br>(U.S./I-P)  | <b>2.38</b><br>(Metric/SI) | <b>0.27</b>   |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>  |                            |   |
| Visible Transmittance  |                            |   |
| <b>0.50</b>  |                            |   |
| <small>Manufacturer stipulates that the ratings conform to applicable NFRC procedures for determining product performance. NFRC ratings are determined for a limited set of environmental conditions and a specific product size. NFRC does not recommend any product and does not warrant the suitability of any product for any specific use. Consult manufacturer's literature for complete product performance information. <a href="http://www.nfrc.org">www.nfrc.org</a></small> |                            |   |
|  |                            | <small>License # 4114H-02<br/>Silver Line Window<br/>2127 Single Hung - IMPACT<br/>Manufacturer Stipulates Certification to the following standards</small> |
| <b>STANDARD</b>  |                            | <b>RATING</b>   |
| AAMA/WDMA/CSA 101/I.5 2/A440-08  |                            | CLASS R-P655 Size Tested 52 x 73 in<br>DP +55/-55 psf   |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - HVHZ   |                            | Wind Zone 4 - Missile Level D<br>Cycle Pressure +55/-50   |
| FL 14911   |                            |   |
| <small>Glazing 3.0 mm Double Str AN Outer/<br/>6.7 mm 090 SS Lami Inner<br/>Laminator NE LC Interlayers RNB 090</small>  |                            |   |
| <b>ATL N-7</b>   |                            | <small>Complies with HUD UM Bulletin 111<br/>IGCC<sub>2</sub>/IGMA<sub>2</sub> 03-17</small><br><b>23707987.14.2</b>  |

Meets or exceeds MEC, CEC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program

# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5541 Rosehill Rd bldg 18  
Sarasota FL 34233

[www.MISInspect.com](http://www.MISInspect.com)

7186 21st Street E.

Sarasota, FL 34243

(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|   |                 |                 |
|---|-----------------|-----------------|
| Inspection Date: November 27, 2018        |                 |                 |
| <b>Owner Information</b>                  |                 |                 |
| Owner Name: Admiral's Walk, A Condominium |                 | Contact Person: |
| Address: 5541 Rosehill Rd bldg 18         |                 | Home Phone:     |
| City: Sarasota                            | Zip: 34233      | Work Phone:     |
| County: Sarasota                          |                 | Cell Phone:     |
| Insurance Company:                        |                 | Policy #:       |
| Year of Home: 2002                        | # of Stories: 2 | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

1. **Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_/\_\_\_/\_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
2. **Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date             | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | <u>07</u> / <u>10</u> / <u>2017</u> | _____                         | <u>2017</u>                                  | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
- B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
- C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
- D. No roof coverings meet the requirements of Answer "A" or "B".

3. **Roof Deck Attachment:** What is the **weakest** form of roof deck attachment?
  - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
  - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
  - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials ZM Property Address 5541 Rosehill Rd bldg 18 Sarasota FL 34233



or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a 1/2" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.
- B. Clips
  - Metal connectors that do not wrap over the top of the truss/rafter, **or**
  - Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.
- C. Single Wraps
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.
- D. Double Wraps
  - Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.
- E. Structural Anchor bolts structurally connected or reinforced concrete roof.
- F. Other: \_\_\_\_\_
- G. Unknown or unidentified
- H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials ZM Property Address 5541 Rosehill Rd bldg 18 Sarasota FL 34233

**\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.**

7. **Opening Protection:** What is the weakest form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |


- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials ZM Property Address 5541 Rosehill Rd bldg 18 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.





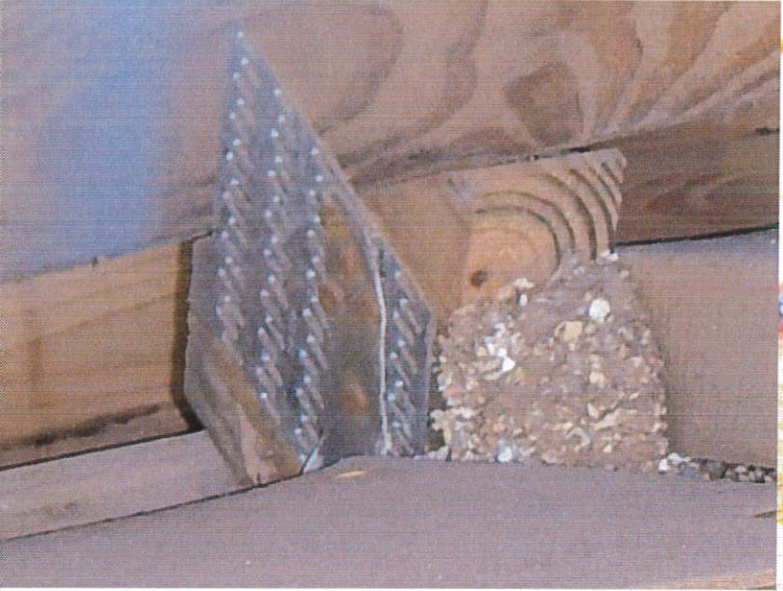



# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**"7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, and 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, and 203
- \_ American Society for Testing and Materials (ASTM) E 1886 and ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 and ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115"

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*

**THERMATRU**  
DOORS

Maumee, Ohio  
www.thermatru.com  
800-843-7628

IT LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Thermo-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAMI certification, Florida and TDI approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Thermo-Tru Classic-Craft, Fiber-Classic, Smooth-Star, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshal requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official.

Thank you for  
selecting quality  
Silver Line products



CPD: SIL-N-3-01359-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|  |   |   |
|--|---|---|
| U-Factor   |   | Solar Heat Gain Coefficient   |
| <b>0.42</b><br>(U.S./I-P)  | <b>2.38</b><br>(Metric/SI)                              | <b>0.27</b>   |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>  |   |   |
| Visible Transmittance  |   |   |
| <b>0.50</b>  |   |   |
| <small>Manufacturer stipulated that the ratings on this product are based on applicable NFRCC procedures for determining product performance. NFRCC ratings are determined for a fixed set of environmental conditions and are not warranted for any specific product size. NFRCC does not recommend any product and does not warrant the durability of any product for any specific use. Consult manufacturer's literature for correct product performance information. nfrcc.org</small> |   |   |
|  |   | <small>License # 4114-H-07</small><br>Silver Line Windows<br>2127 Single Hung - IMPACT<br>Manufacturer States Certification to the following standards: |
| Hallmark Certified<br>www.wdma.com   |   |   |
| <b>STANDARD</b>  | <b>RATING</b>   |   |
| APR/WDMA/CSA 101/I.5 2/A440-08   | CLASS R-P655 Size Tested 52 x 73 in.<br>DP +55/-55 psf  |   |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - 4VHZ   | Wind Zone 4 / Missile Level D<br>Cycle Pressure +55/-55 |   |
| FL 14911   |   |   |
| Glazing 3.0 mm Double Str AN Outer<br>6.7 mm 090 SS Lami Inner<br>Laminator: NE LC Interlayer: HVB 090   |   |   |
| <b>ATL N-7</b>   |   | Complies with HUD UM Bulletin 111<br>IGCC/IGMA 03-17<br><b>23707987.14.2</b>  |

Meets or exceeds MEC, CBC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program



# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5551 Rosehill Rd., Bldg 19

Sarasota 34233

[www.MISinspect.com](http://www.MISinspect.com)

7186 21st Street E.

Sarasota, FL 34243

(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|  |                 |                 |
|--|-----------------|-----------------|
| Inspection Date: November 27, 2018       |                 |                 |
| <b>Owner Information</b>                 |                 |                 |
| Owner Name: Admirals Walk, A Condominium |                 | Contact Person: |
| Address: 5551 Rosehill Rd., Bldg 19      |                 | Home Phone:     |
| City: Sarasota                           | Zip: 34233      | Work Phone:     |
| County: Sarasota                         |                 | Cell Phone:     |
| Insurance Company:                       |                 | Policy #:       |
| Year of Home: 2002                       | # of Stories: 2 | Email:          |

**NOTE:** Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.

- Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_ / \_\_\_ / \_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
- Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | 10 / 25 / 2017          | _____                         | 2017   | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ___ / ___ / _____       | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ___ / ___ / _____       | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ___ / ___ / _____       | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ___ / ___ / _____       | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ___ / ___ / _____       | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
  - B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
  - C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
  - D. No roof coverings meet the requirements of Answer "A" or "B".
- Roof Deck Attachment:** What is the weakest form of roof deck attachment?
    - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
    - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
    - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials WM Property Address 5551 Rosehill Rd., Bldg 19 Sarasota 34233

or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a 1/2" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.

B. Clips

- Metal connectors that do not wrap over the top of the truss/rafter, **or**
- Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.

C. Single Wraps

Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.

D. Double Wraps

- Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
- Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.

E. Structural      Anchor bolts structurally connected or reinforced concrete roof.

F. Other: \_\_\_\_\_

G. Unknown or unidentified

H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof      Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof      Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof      Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials WM Property Address \_\_\_\_\_ 5551 Rosehill Rd., Bldg 19      Sarasota      34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

7. **Opening Protection:** What is the weakest form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, and 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, and 203
  - American Society for Testing and Materials (ASTM) E 1886 and ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 and ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 and ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 and ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials WM Property Address 5551 Rosehill Rd., Bldg 19 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.

|   |  |  |
|---|--|--|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |  |  |
| Qualified Inspector Name:<br><b>Wade Marquette</b>  | License Type:<br><b>Home Inspector</b> | License or Certificate #:<br><b>HI2853</b> |
| Inspection Company:<br><b>Marquette Inspection, Inc</b>   | Phone:<br><b>(941)358-1901</b>         |  |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Wade Marquette am a qualified inspector and I personally performed the inspection or (*licensed (print name)*  
*contractors and professional engineers only*) I had my employee (Wade Marquette) perform the inspection  
(*print name of inspector*)  
and I agree to be responsible for his/her work.

Qualified Inspector Signature:  Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**

**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.


Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials WM Property Address 5551 Rosehill Rd., Bldg 19 Sarasota 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

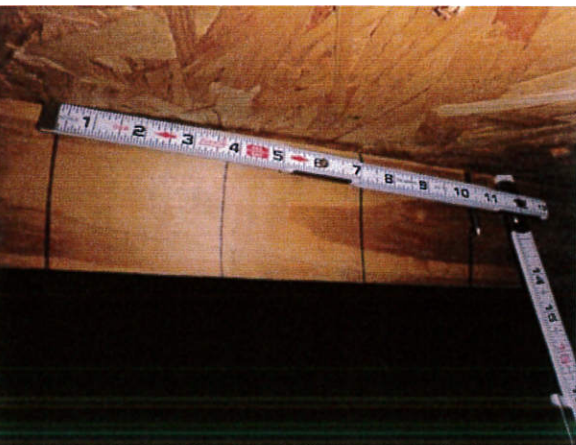





# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**"7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, **and** 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
- \_ American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 **and** ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115"

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*



**THERMA-TRU**  
DOORS

Maumee, Ohio  
www.thermatru.com  
800-843-7628

IT LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Therma-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAIMI certification, Florida and TDI approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Therma-Tru Classic-Craft, Fiber-Classic, Smooth-Star, and Pro-Select fiberglass opaque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshal requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official.

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-0189-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|   |                            |  |
|---|----------------------------|--|
| U-Factor  |                            | Solar Heat Gain Coefficient  |
| <b>0.42</b><br>(U.S./I-P)   | <b>2.38</b><br>(Metric/SI) | <b>0.27</b>  |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>   |                            |  |
| Visible Transmittance   |                            |  |
| <b>0.50</b>   |                            |  |
| <small>Manufacturer stipulates that these ratings conform to applicable NFRC procedures for determining product performance. NFRC ratings are determined for a fixed set of environmental conditions and a specific product size. NFRC does not recommend any product and does not warrant the suitability of any product for any specific use. Consult manufacturer's literature for correct product performance. Visit <a href="http://www.nfrc.org">www.nfrc.org</a></small> |                            |  |
|   |                            | <small>License # 4114H-07<br/>Silver Line Windows<br/>2127 Single Hung - IMPACT<br/>Manufacturer Stipulates Certification to the following standards</small> |
| <b>STANDARD</b>   |                            | <b>RATING</b>  |
| APPA/WDMA/CSA 101/I.5 2/A440-08   |                            | CLASS R-PG55 Size Tested 52 x 73 In<br>DP +55/-55 pnf  |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - 4VHZ  |                            | Wind Zone 4 - Mississ Level D<br>Cyclic Pressure +55/-50   |
| FL 14911  |                            |  |
| <small>Glazing 3.0 mm Double Str AN Outer<br/>6.7 mm 090 SS Lami Inner<br/>Laminator: NE LC Interlayer: PVB 090</small>   |                            |  |
| <b>ATL N-7</b>  |                            | <small>Complies with HUD UM Bulletin 111<br/>IGCC, IGMA 03-17<br/><b>23707987.14.2</b></small>   |

Meets or exceeds MEC, CEC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program

# Wind Mitigation Inspection



# MARQUETTE INSPECTION

5540 Rosehill Rd bldg 20  
Sarasota FL 34233

[www.MISinspect.com](http://www.MISinspect.com)

7186 21st Street E.  
Sarasota, FL 34243  
(941)358-1901

# Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy

|   |                 |                 |
|---|-----------------|-----------------|
| Inspection Date: November 27, 2018        |                 |                 |
| <b>Owner Information</b>                  |                 |                 |
| Owner Name: Admiral's Walk, A Condominium |                 | Contact Person: |
| Address: 5540 Rosehill Rd bldg 20         |                 | Home Phone:     |
| City: Sarasota                            | Zip: 34233      | Work Phone:     |
| County: Sarasota                          |                 | Cell Phone:     |
| Insurance Company:                        |                 | Policy #:       |
| Year of Home: 2002                        | # of Stories: 2 | Email:          |

**NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph must accompany this form to validate each attribute marked in questions 3 through 7. The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.**

- Building Code:** Was the structure built in compliance with the Florida Building Code (FBC 2001 or later) OR for homes located in the HVHZ (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94)?
  - A. Built in compliance with the FBC: Year Built 2002. For homes built in 2002/2003 provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) 2 / 27 / 2002
  - B. For the HVHZ Only: Built in compliance with the SFBC-94: Year Built \_\_\_\_\_. For homes built in 1994, 1995, and 1996 provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) \_\_\_/\_\_\_/\_\_\_\_\_
  - C. Unknown or does not meet the requirements of Answer "A" or "B"
- Roof Covering:** Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number OR Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

| 2.1 Roof Covering Type:   | Permit Application Date             | FBC or MDC Product Approval # | Year of Original Installation or Replacement | No Information Provided for Compliance |
|---|-------------------------------------|-------------------------------|--|--|
| <input checked="" type="checkbox"/> 1. Asphalt/Fiberglass Shingle | <u>07</u> / <u>07</u> / <u>2017</u> | _____                         | <u>2017</u>                                  | <input type="checkbox"/>               |
| <input type="checkbox"/> 2. Concrete/Clay Tile                    | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 3. Metal                                 | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 4. Built Up                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 5. Membrane                              | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |
| <input type="checkbox"/> 6. Other _____                           | ___/___/___                         | _____                         | _____  | <input type="checkbox"/>               |

- A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
  - B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
  - C. One or more roof coverings do not meet the requirements of Answer "A" or "B".
  - D. No roof coverings meet the requirements of Answer "A" or "B".
- Roof Deck Attachment:** What is the **weakest** form of roof deck attachment?
    - A. Plywood/Oriented strand board (OSB) roof sheathing attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. -OR- Batten decking supporting wood shakes or wood shingles. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean uplift less than that required for Options B or C below.
    - B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 12" inches in the field. -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12 inches in the field or has a mean uplift resistance of at least 103 psf.
    - C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" inch attached to the roof truss/rafter (spaced a maximum of 24" inches o.c.) by 8d common nails spaced a maximum of 6" inches in the field. -OR- Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6 inches in width). -OR- Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent

Inspectors Initials ZM Property Address 5540 Rosehill Rd bldg 20 Sarasota FL 34233

or greater resistance than 8d common nails spaced a maximum of 6 inches in the field or has a mean uplift resistance of at least 182 psf.

- D. Reinforced Concrete Roof Deck.
- E. Other: \_\_\_\_\_
- F. Unknown or unidentified.
- G. No attic access.

4. **Roof to Wall Attachment:** What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within 5 feet of the inside or outside corner of the roof in determination of WEAKEST type)

- A. Toe Nails
  - Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, or
  - Metal connectors that do not meet the minimal conditions or requirements of B, C, or D

**Minimal conditions to qualify for categories B, C, or D. All visible metal connectors are:**

- Secured to truss/rafter with a minimum of three (3) nails, **and**
- Attached to the wall top plate of the wall framing, or embedded in the bond beam, with less than a 1/2" gap from the blocking or truss/rafter **and** blocked no more than 1.5" of the truss/rafter, **and** free of visible severe corrosion.

- B. Clips
  - Metal connectors that do not wrap over the top of the truss/rafter, **or**
  - Metal connectors with a minimum of 1 strap that wraps over the top of the truss/rafter and does not meet the nail position requirements of C or D, but is secured with a minimum of 3 nails.
- C. Single Wraps
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side and a minimum of 1 nail on the opposing side.
- D. Double Wraps
  - Metal Connectors consisting of 2 separate straps that are attached to the wall frame, or embedded in the bond beam, on either side of the truss/rafter where each strap wraps over the top of the truss/rafter and is secured with a minimum of 2 nails on the front side, and a minimum of 1 nail on the opposing side, **or**
  - Metal connectors consisting of a single strap that wraps over the top of the truss/rafter, is secured to the wall on both sides, and is secured to the top plate with a minimum of three nails on each side.
- E. Structural      Anchor bolts structurally connected or reinforced concrete roof.
- F. Other: \_\_\_\_\_
- G. Unknown or unidentified
- H. No attic access

5. **Roof Geometry:** What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

- A. Hip Roof      Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.  
Total length of non-hip features: \_\_\_\_\_ feet; Total roof system perimeter: \_\_\_\_\_ feet
- B. Flat Roof      Roof on a building with 5 or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 \_\_\_\_\_ sq ft; Total roof area \_\_\_\_\_ sq ft
- C. Other Roof      Any roof that does not qualify as either (A) or (B) above.

6. **Secondary Water Resistance (SWR):** (standard underlayments or hot-mopped felts do not qualify as an SWR)

- A. SWR (also called Sealed Roof Deck) Self-adhering polymer modified-bitumen roofing underlayment applied directly to the sheathing or foam adhesive SWR barrier (not foamed-on insulation) applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss.
- B. No SWR.
- C. Unknown or undetermined.

Inspectors Initials ZM Property Address \_\_\_\_\_ 5540 Rosehill Rd bldg 20 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

7. **Opening Protection:** What is the weakest form of wind borne debris protection installed on the structure? **First**, use the table to determine the weakest form of protection for each category of opening. **Second**, (a) check one answer below (A, B, C, N, or X) based upon the lowest protection level for ALL Glazed openings **and** (b) check the protection level for all Non-Glazed openings (.1, .2, or .3) as applicable.

| Opening Protection Level Chart<br>Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (A thru X), based on the weakest form of protection (lowest row) for any of the Glazed openings and indicate the weakest form of protection (lowest row) for Non-Glazed openings. |   | Glazed Openings        |              |           |             | Non-Glazed Openings |              |
|--|---|------------------------|--------------|-----------|-------------|---------------------|--------------|
|  |   | Windows or Entry Doors | Garage Doors | Skylights | Glass Block | Entry Doors         | Garage Doors |
| N/A  | Not Applicable- there are no openings of this type on the structure   |                        | X            | X         | X           |                     |              |
| A  | Verified cyclic pressure & large missile (9-lb for windows doors/4.5 lb for skylights)  | X                      |              |           |             | X                   |              |
| B  | Verified cyclic pressure & large missile (4-8 lb for windows doors/2 lb for skylights)  |                        |              |           |             |                     |              |
| C  | Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007   |                        |              |           |             |                     |              |
| D  | Verified Non-Glazed Entry or Garage doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance |                        |              |           |             |                     |              |
| N  | Opening Protection products that appear to be A or B but are not verified   |                        |              |           |             |                     |              |
|  | Other protective coverings that cannot be identified as A, B, or C  |                        |              |           |             |                     |              |
| X  | No Windborne Debris Protection  |                        |              |           |             |                     | X            |

- A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above).
- Miami-Dade County PA 201, 202, **and** 203
  - Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
  - American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
  - Southern Standards Technical Document (SSTD) 12
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996
  - For Garage Doors Only: ANSI/DASMA 115
- A.1 All Non-Glazed openings classified as A in the table above, or no Non-Glazed openings exist
- A.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level B, C, N, or X in the table above
- A.3 One or More Non-Glazed Openings is classified as Level B, C, N, or X in the table above
- B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb Large Missile (2-4.5 lb for skylights only)** All Glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above):
- ASTM E 1886 **and** ASTM E 1996 (Large Missile – 4.5 lb.)
  - SSTD 12 (Large Missile – 4 lb. to 8 lb.)
  - For Skylights Only: ASTM E 1886 **and** ASTM E 1996 (Large Missile - 2 to 4.5 lb.)
- B.1 All Non-Glazed openings classified as A or B in the table above, or no Non-Glazed openings exist
- B.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level C, N, or X in the table above
- B.3 One or More Non-Glazed openings is classified as Level C, N, or X in the table above
- C. Exterior Opening Protection- Wood Structural Panels meeting FBC 2007** All Glazed openings are covered with plywood/OSB meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above).
- C.1 All Non-Glazed openings classified as A, B, or C in the table above, or no Non-Glazed openings exist
- C.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level N or X in the table above
- C.3 One or More Non-Glazed openings is classified as Level N or X in the table above

Inspectors Initials ZM Property Address 5540 Rosehill Rd bldg 20 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.

- N. Exterior Opening Protection (unverified shutter systems with no documentation)** All Glazed openings are protected with protective coverings not meeting the requirements of Answer "A", "B", or "C" or systems that appear to meet Answer "A" or "B" with no documentation of compliance (Level N in the table above).
  - N.1 All Non-Glazed openings classified as Level A, B, C, or N in the table above, or no Non-Glazed openings exist
  - N.2 One or More Non-Glazed openings classified as Level D in the table above, and no Non-Glazed openings classified as Level X in the table above
  - N.3 One or More Non-Glazed openings is classified as Level X in the table above
- X. None or Some Glazed Openings** One or more Glazed openings classified and Level X in the table above.

|   |  |   |
|---|--|---|
| <b>MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.</b><br><i>Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.</i> |  |   |
| Qualified Inspector Name:<br><b>Zachary Marquette</b>   | License Type:<br><b>Home Inspector</b> | License or Certificate #:<br><b>HI 5086, 18020398</b> |
| Inspection Company:<br><b>Marquette Inspection, Inc.</b>  | Phone:<br><b>(941)358-1901</b>         |   |

**Qualified Inspector – I hold an active license as a: (check one)**

- Home inspector licensed under Section 468.8314, Florida Statutes who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.
- Building code inspector certified under Section 468.607, Florida Statutes.
- General, building or residential contractor licensed under Section 489.111, Florida Statutes.
- Professional engineer licensed under Section 471.015, Florida Statutes.
- Professional architect licensed under Section 481.213, Florida Statutes.
- Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

**Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under s.471.015 or s.489.111 may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.**

I, Zachary Marquette am a qualified inspector and I personally performed the inspection or (*licensed*  
(print name)  
*contractors and professional engineers only*) I had my employee ( \_\_\_\_\_ ) perform the inspection  
(print name of inspector)  
and I agree to be responsible for his/her work.

Qualified Inspector Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Florida Division of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution. (Section 627.711(4)-(7), Florida Statutes) The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.**

**Homeowner to complete:** I certify that the named Qualified Inspector or his or her employee did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: \_\_\_\_\_ Date: November 27, 2018

**An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree. (Section 627.711(7), Florida Statutes)**


The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials ZM Property Address \_\_\_\_\_ 5540 Rosehill Rd bldg 20 Sarasota FL 34233

\*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form.





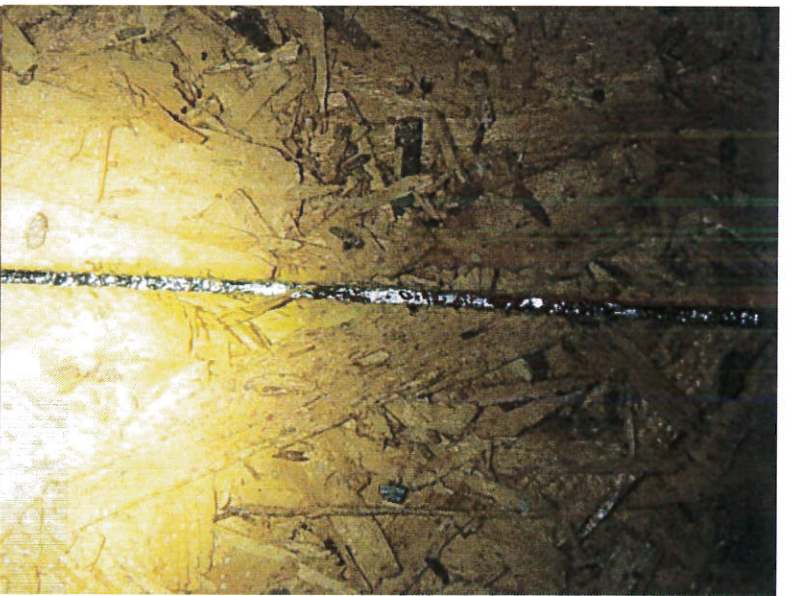



# MARQUETTE INSPECTION, INC

[www.MISinspect.com](http://www.MISinspect.com)

Lynn Marquette  
7186 21<sup>st</sup> St. E.  
Sarasota, Florida 34243  
Ph: (941) 358-1901  
[marquetteinspect@gmail.com](mailto:marquetteinspect@gmail.com)

January 9, 2019

To Whom It May Concern:

Marquette Inspection, Inc. performed wind mitigation inspections on Admiral's Walk, A Condominium, including thirty one (31) buildings. All doors and windows were inspected in each building to confirm that all windows and entry doors meet the standard listed as:

**“7A. Exterior Openings Cyclic Pressure and 9-lb Large Missile (4.5 lb for skylights only)** All Glazed openings are protected at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for “Cyclic Pressure and Large Missile Impact” (Level A in the table above).

- \_ Miami-Dade County PA 201, 202, **and** 203
- \_ Florida Building Code Testing Application Standard (TAS) 201, 202, **and** 203
- \_ American Society for Testing and Materials (ASTM) E 1886 **and** ASTM E 1996
- \_ Southern Standards Technical Document (SSTD) 12
- \_ For Skylights Only: ASTM E 1886 **and** ASTM E 1996
- \_ For Garage Doors Only: ANSI/DASMA 115”

Please find the windows and doors stickers attached.

Best Regards,

*Lynn Marquette*  
*Marquette Inspection, Inc.*

**THERMA TRU**  
DOORS

Maumee, Ohio  
www.thermatru.com  
800-843-7628

IT LABEL MAY 13

Performance data, product approvals and product certifications are available for certain Thermo-Tru door systems, including the following: Structural design pressure, missile impact, air infiltration, water penetration, forced entry, sound transmission, thermal performance, NFRC certification, ENERGY STAR® qualification, HUD certification, NAIMI certification, Florida and TDJ approval and fire door certifications. Performance data, product approvals and product certifications do not apply to all products or systems. Specified manufacture, assembly and installation of approved and certified products and systems is required. All Thermo-Tru Classic-Craft, Fiber-Classic, Smooth-Star, and Pro-Select fiberglass casque exterior doors have been tested in accordance with SFM 12-7A-1 and meet the California State Fire Marshal requirements for use in the Wildland Urban Interface. Visit [www.thermatru.com](http://www.thermatru.com) for full test report.

Do not remove until final inspections by code official.

Thank you for  
selecting quality  
Silver Line products



CPD SIL-N-3-01009-00001  
2127 Single Hung - IMPACT  
Resistant Vinyl Dual Glazed Vinyl  
Dual Glazed Low-E Grids  
ENERGY PERFORMANCE RATINGS

|  |                            |  |
|--|----------------------------|--|
| U-Factor   |                            | Solar Heat Gain Coefficient  |
| <b>0.42</b><br>(U.S./I-P)  | <b>2.38</b><br>(Metric/SI) | <b>0.27</b>  |
| <b>ADDITIONAL PERFORMANCE RATINGS</b>  |                            |  |
| Visible Transmittance  |                            |  |
| <b>0.50</b>  |                            |  |
| <small>Manufacturer stipulates that the ratings conform to applicable NFRC procedures for determining product performance. NFRC ratings are determined for a fixed set of environmental conditions and a specific product size. NFRC does not recommend any contractor or dealer not warrant the suitability of any product for any specific use. Consult manufacturer's literature for complete product details. <a href="http://www.nfrc.org">www.nfrc.org</a></small> |                            |  |
|  |                            | <small>License # 4114H-07<br/>Silver Line Windows<br/>2127 Single Hung - IMPACT<br/>Manufacturer Stipulates Certification to the following standards</small> |
| <b>STANDARD</b>  |                            | <b>RATING</b>  |
| APMA/WDMA/CSA 101/I.5 2/A440-08  |                            | CLASS R-PG55 Size Tested 52 x 73 in.<br>DP +55/-55 psf   |
| ASTM E1996-12/ASTM E1886-05<br>TAS-201 thru 203 - HVHZ   |                            | Wind Zone 4 - Hissile Level D<br>Cyclic Pressure +55/-50   |
| FL 14911   |                            |  |
| <small>Glazing 3.0 mm Double Str. AN Outer/<br/>6.7 mm 090 55 Lami Inner<br/>Laminator: NE LC Interlayers PVB 090</small>  |                            |  |
| <b>ATL N-7</b>   |                            | <small>Complies with HUD UM Bulletin 111<br/>IGCC<sub>g</sub>/IGMA<sub>g</sub> 03-17</small><br><b>23707987.14.2</b>   |

Meets or exceeds NEC, CBC & IECC Air Infiltration Requirements WDMA Hallmark Certification Program